

ALL WIRING SHOULD BE DONE BY A QUALIFIED ELECTRICIAN IN ACCORDANCE WITH ARTICLE 455 OF THE NATIONAL ELECTRIC CODE® AND ALL OTHER APPLICABLE CODES.


SEE THE ROTO-CON MANUAL, ROTARY NAMEPLATE, PANEL NAMEPLATE, AND LOAD EQUIPMENT NAMEPLATES FOR AMPERAGE RATINGS AND OTHER IMPORTANT INFORMATION.

SEE ARTICLE 250 OF NEC® FOR PROPER GROUNDING OF ALL ENCLOSURES.

THREE-PHASE CONDUCTORS SIZED FOR LOAD IN ACCORDANCE WITH NEC.

* SINCE CAPACITOR PANEL #2 IS BEING UTILIZED, WE RECOMMEND USING THE NEXT SIZE LARGER WIRE.

DO NOT CONNECT CONTROL TRANSFORMERS OR OTHER 1Ø LOADS TO "A" PHASE (PHASE WITH HIGHEST VOLTAGE TO GROUND) FROM THE CONVERTER.

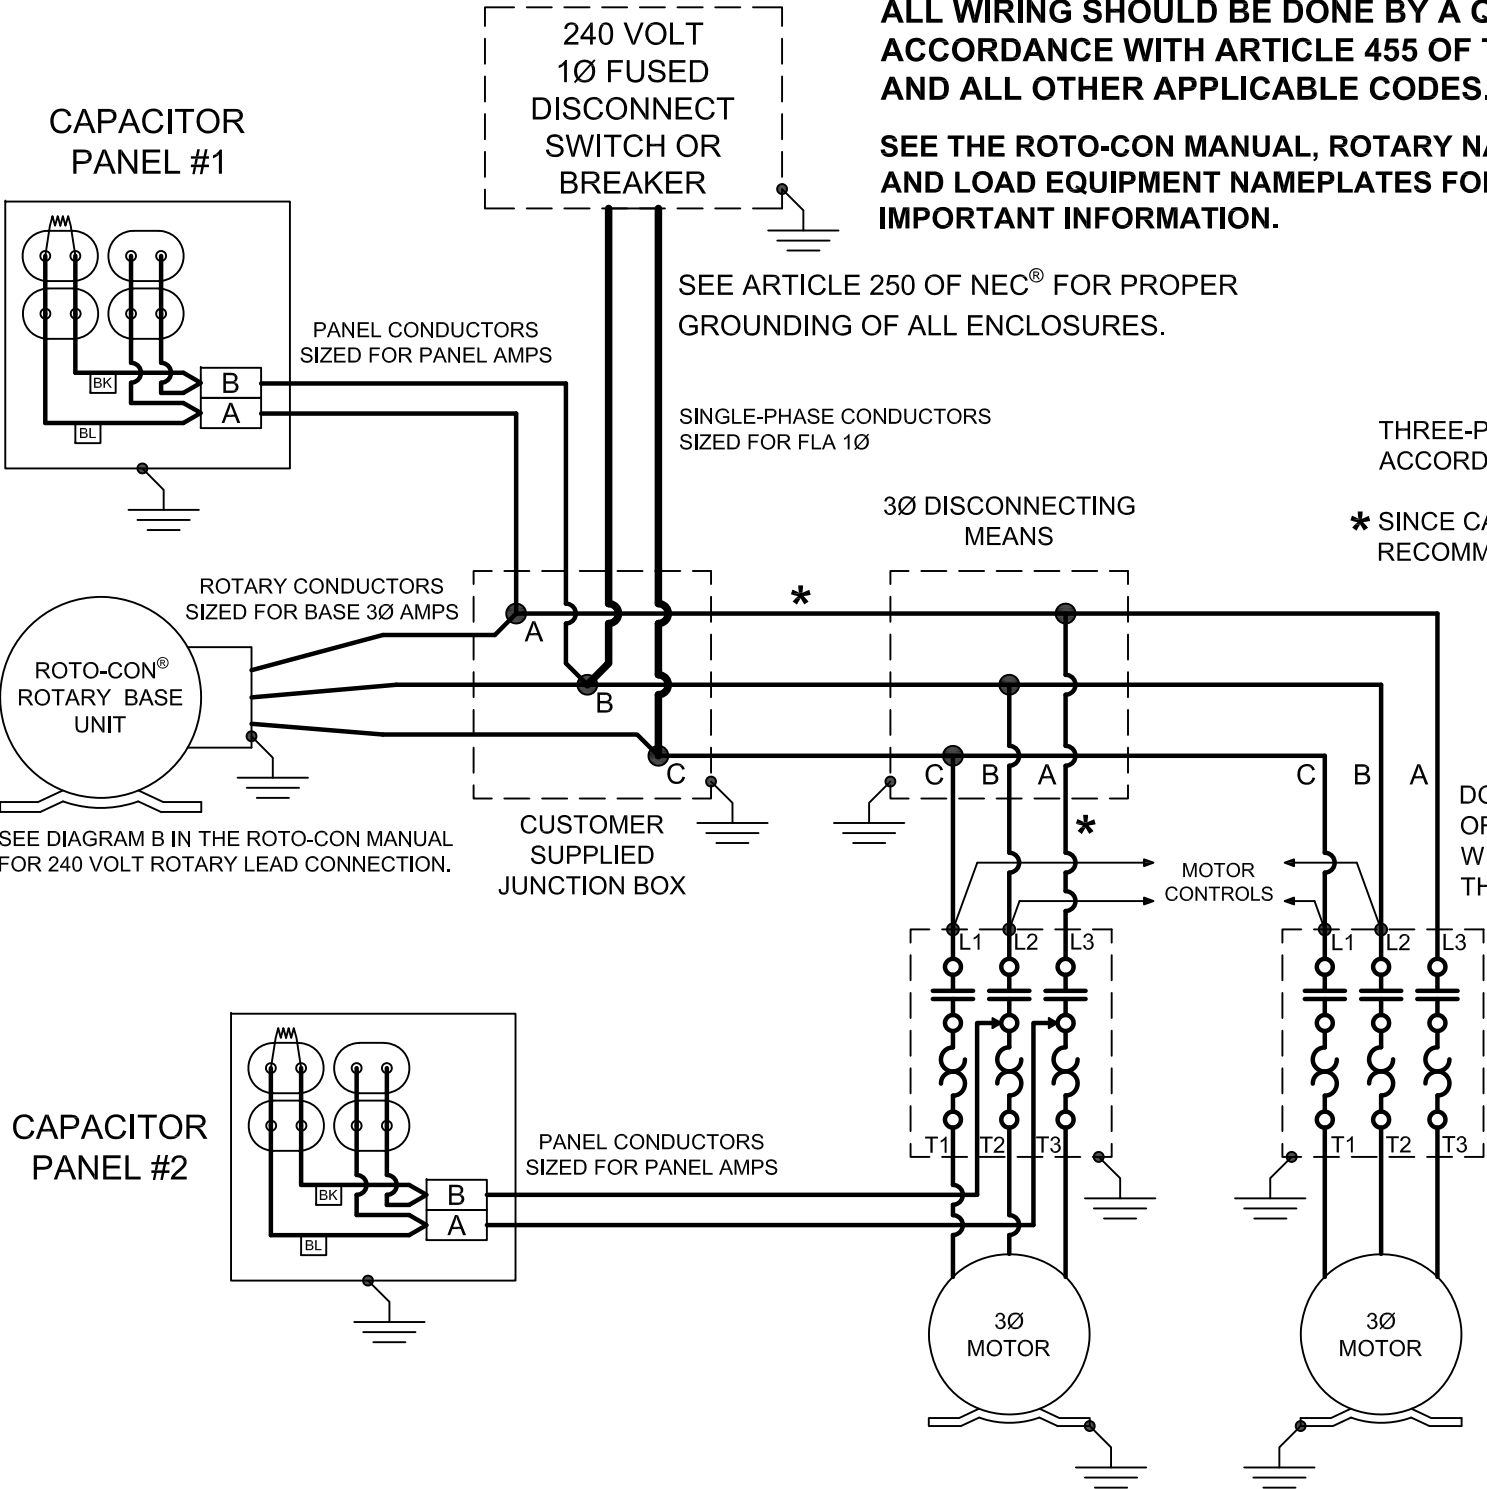

UNITS WITH 2 CAPACITOR PANELS

REVISIONS			ROTO-CON® TYPE 2P MODEL 92	
A	12/2/09	PG		
B	12/23/24	NCL	RONK ELECTRICAL INDUSTRIES NOKOMIS, IL 62075	
			DRAWN - JRW	DRWG. NO. 2-4499B
			DATE - 4/24/92	
			APP'D - CMH	