


ALL WIRING SHOULD BE DONE BY A QUALIFIED ELECTRICIAN IN ACCORDANCE WITH ARTICLE 455 OF THE NATIONAL ELECTRIC CODE® AND ALL OTHER APPLICABLE CODES.

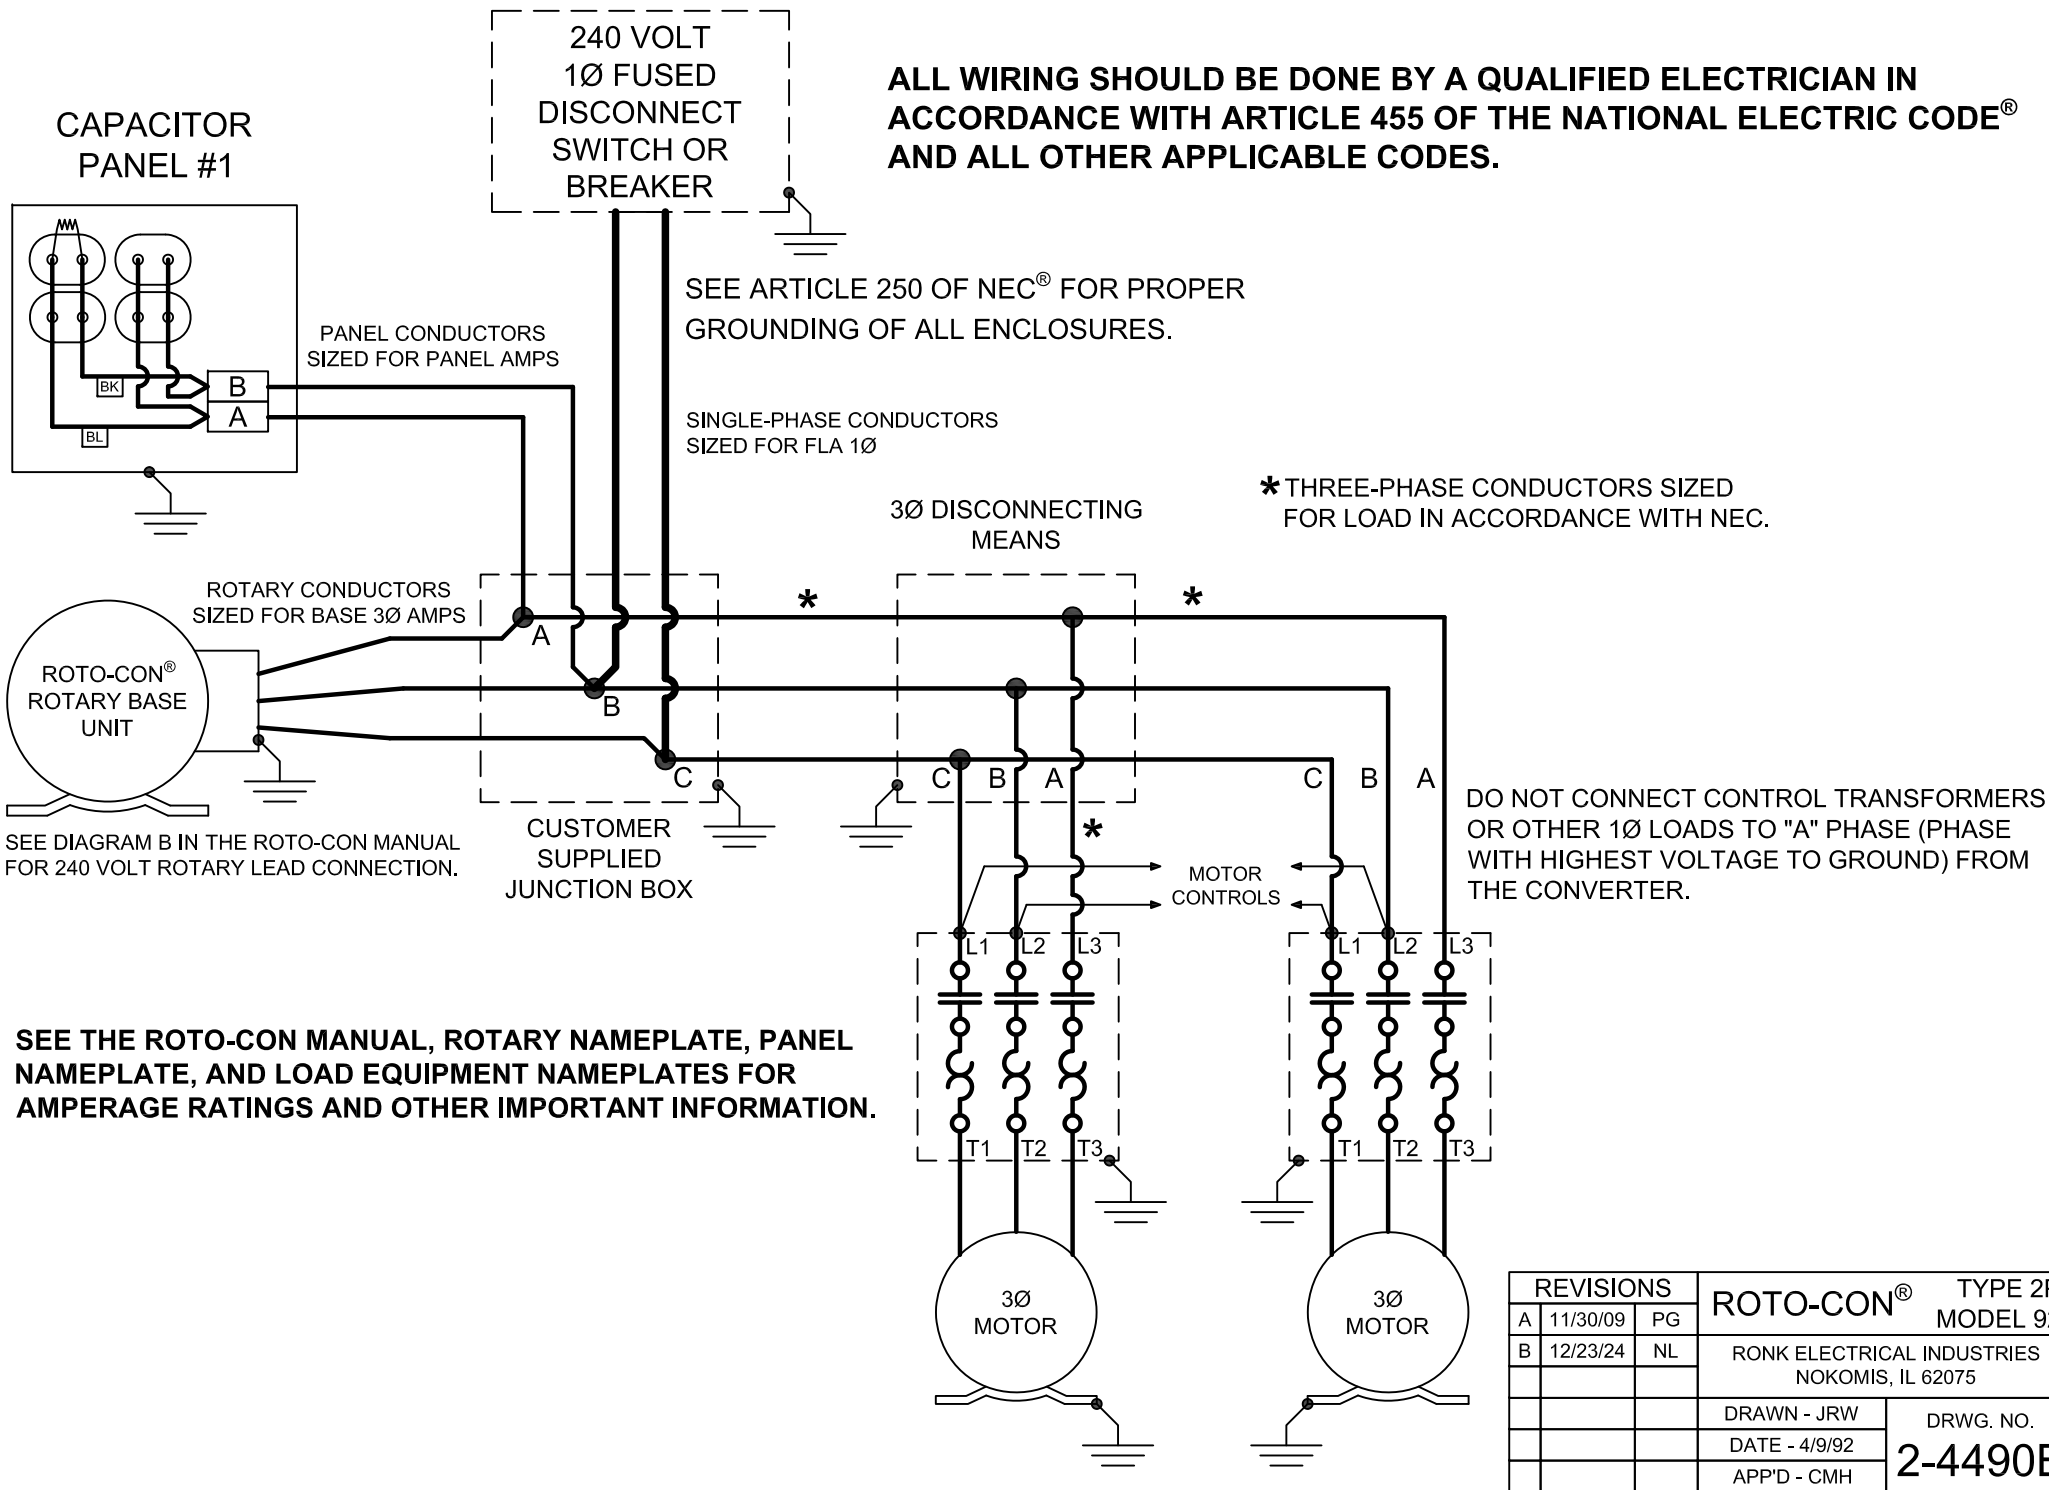

REVISIONS			ROTO-CON® TYPE 2P	
A	11/30/09	PG	MODEL 92	
B	12/23/24	NL	RONK ELECTRICAL INDUSTRIES	
			NOKOMIS, IL 62075	
			DRAWN - JRW	DRWG. NO. 2-4490B
			DATE - 4/9/92	
			APP'D - CMH	